
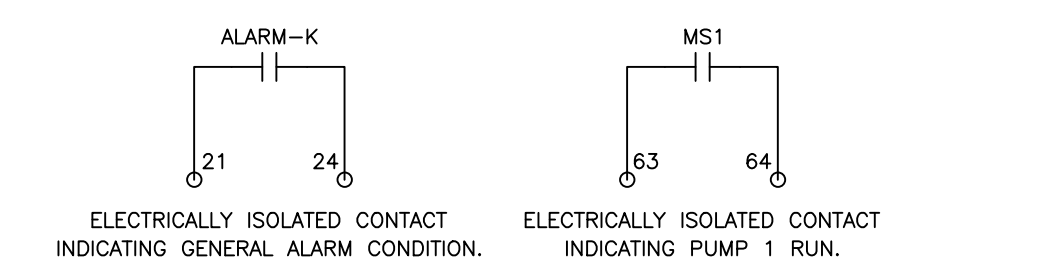


- GENERAL NOTES:**
- TYPE 4 ENCLOSURE, 30" x 30" x 9".
 - SHORT CIRCUIT CURRENT RATING: 5,000 AMPS RMS SYMMETRICAL.
 - CONTROL PANEL IS BUILT, INSPECTED, AND LABELED IN ACCORDANCE WITH UL-508A.

- NOTES:**
- 460 VAC, 3Ø, 60 HZ SERVICE. USE COPPER WIRE, 75° C INSULATION. FIELD TO INSTALL DISCONNECTING MEANS AND FUSE/BREAKER PROTECTION.
 - 24 VOLTS DC.
 - THE SHELF STATE OR TANK-EMPTY STATE OF EACH FIELD DEVICE IS SHOWN IN PARENTHESES.

- LEGEND:**
- AS = ALARM SILENCE
 - CB = CIRCUIT BREAKER
 - DCPS = DC POWER SUPPLY
 - DP = DIFFERENTIAL PRESSURE
 - F = FUSE
 - FM = FUEL MAINTENANCE
 - G = GROUND
 - HOAS = HAND-OFF-AUTO SWITCH
 - HP = HORSEPOWER
 - K = CONTROL RELAY
 - L = LINE
 - M = MOTOR
 - MS = MOTOR STARTER
 - N = NEUTRAL
 - NC = NORMALLY CLOSED
 - NO = NORMALLY OPEN
 - OL = OVERLOAD
 - PLC = PROGRAMMABLE LOGIC CONTROLLER
 - RL = RUN LIGHT
 - SV = SOLENOID VALVE

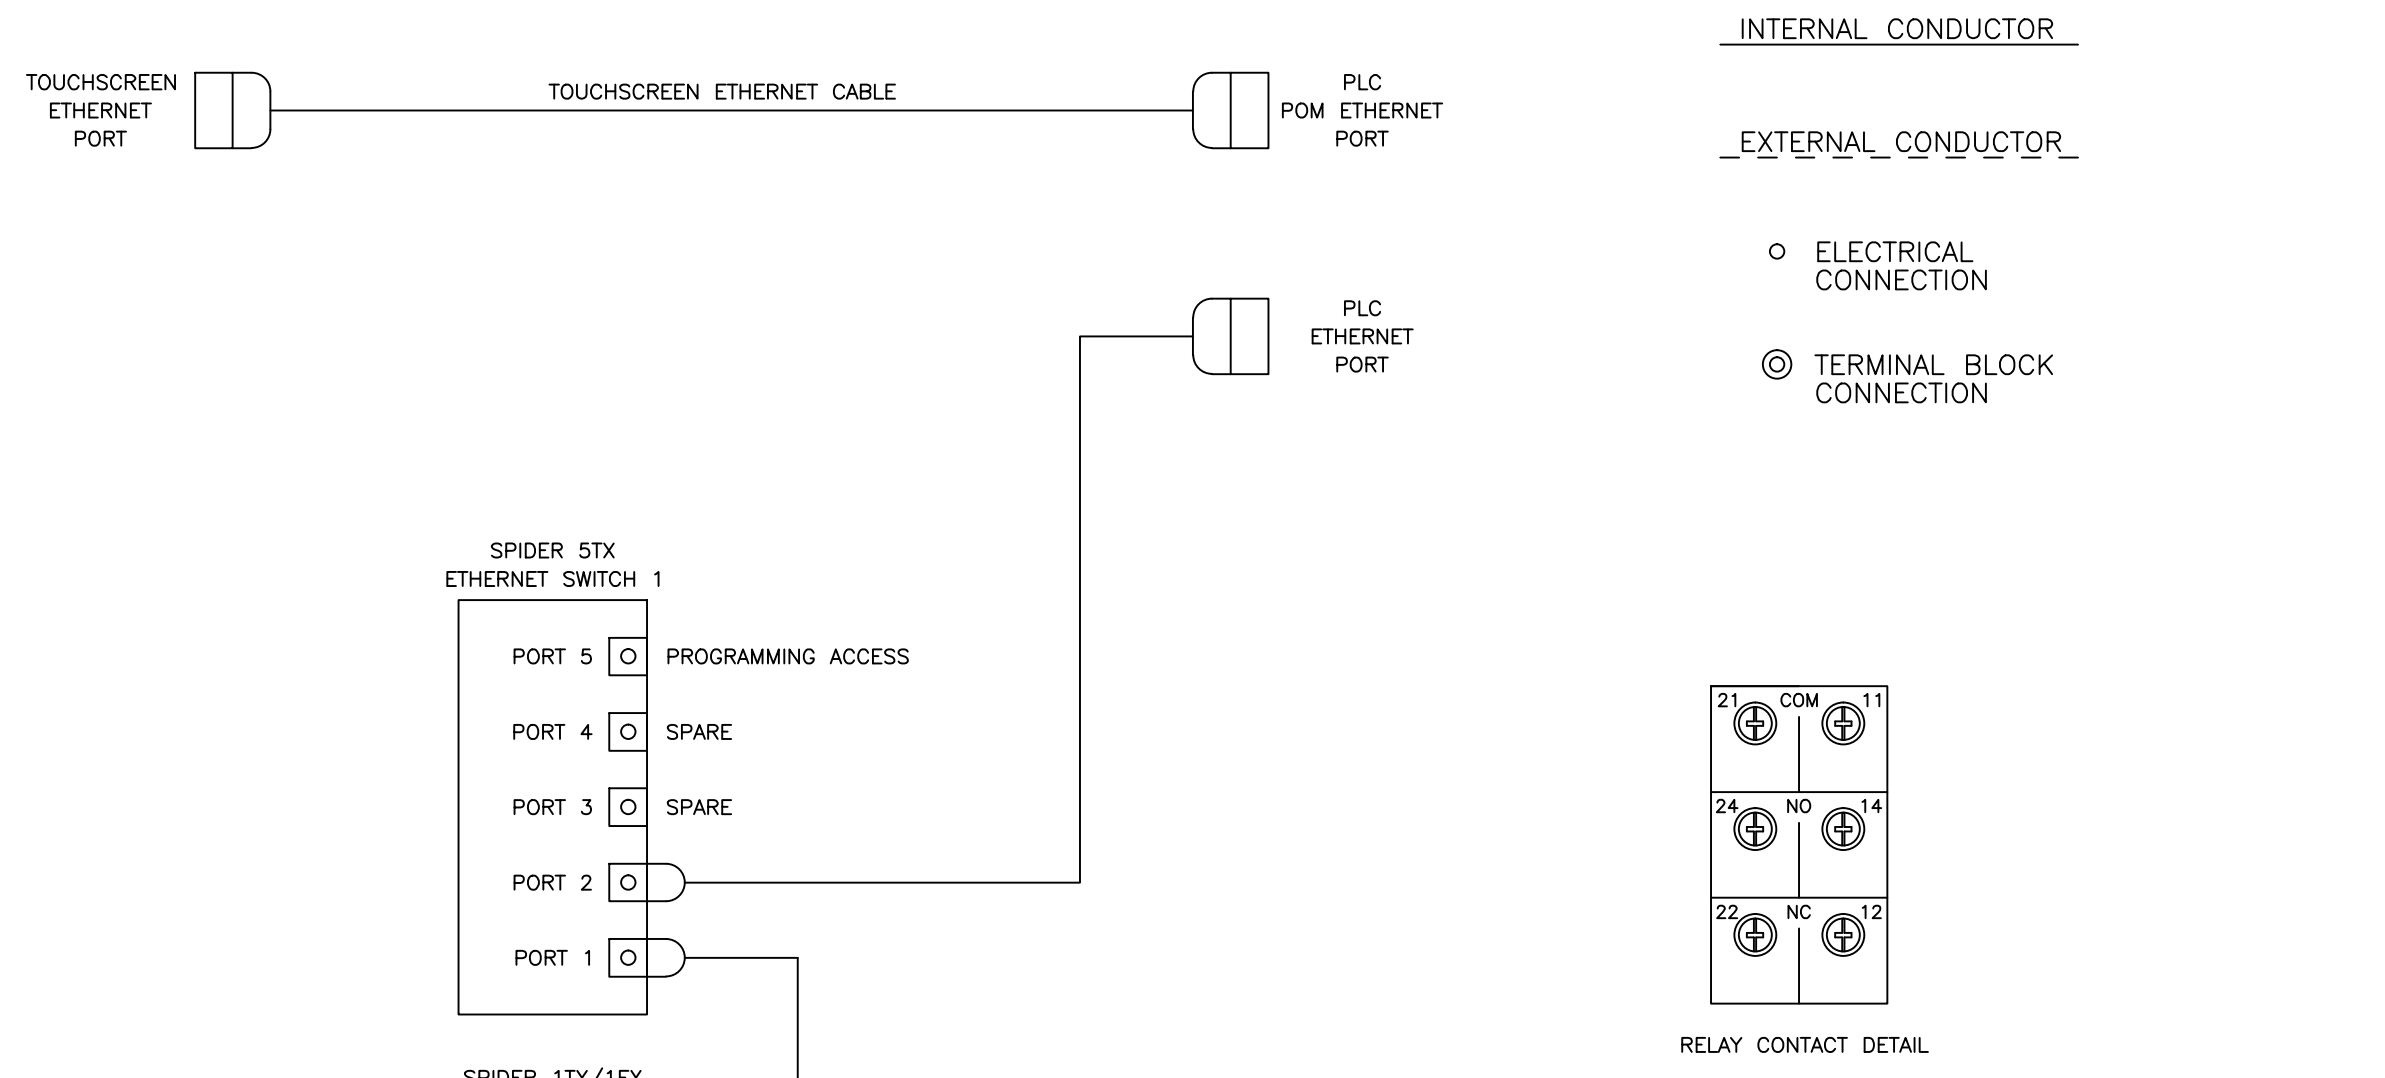

Revisions:

BFS INDUSTRIES, LLC
BUTNER, NORTH CAROLINA

DESCRIPTION: **FME20610 FILTRATION**

S.O.#: _____
JOB: _____
CUSTOMER: _____

Scale: NONE Date: _____ Drawing no: _____
Drawn: _____
Approved: J. Samborsky 1999FM-SC 0

THIS DRAWING IS THE PROPERTY OF BFS INDUSTRIES, LLC, AND IS SUBJECT TO CHANGE WITHOUT NOTICE. THE INFORMATION CONTAINED HEREIN IS TO BE USED ONLY FOR THE JOB INDICATED, AND IS NOT TO BE COPIED, TRANSMITTED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.